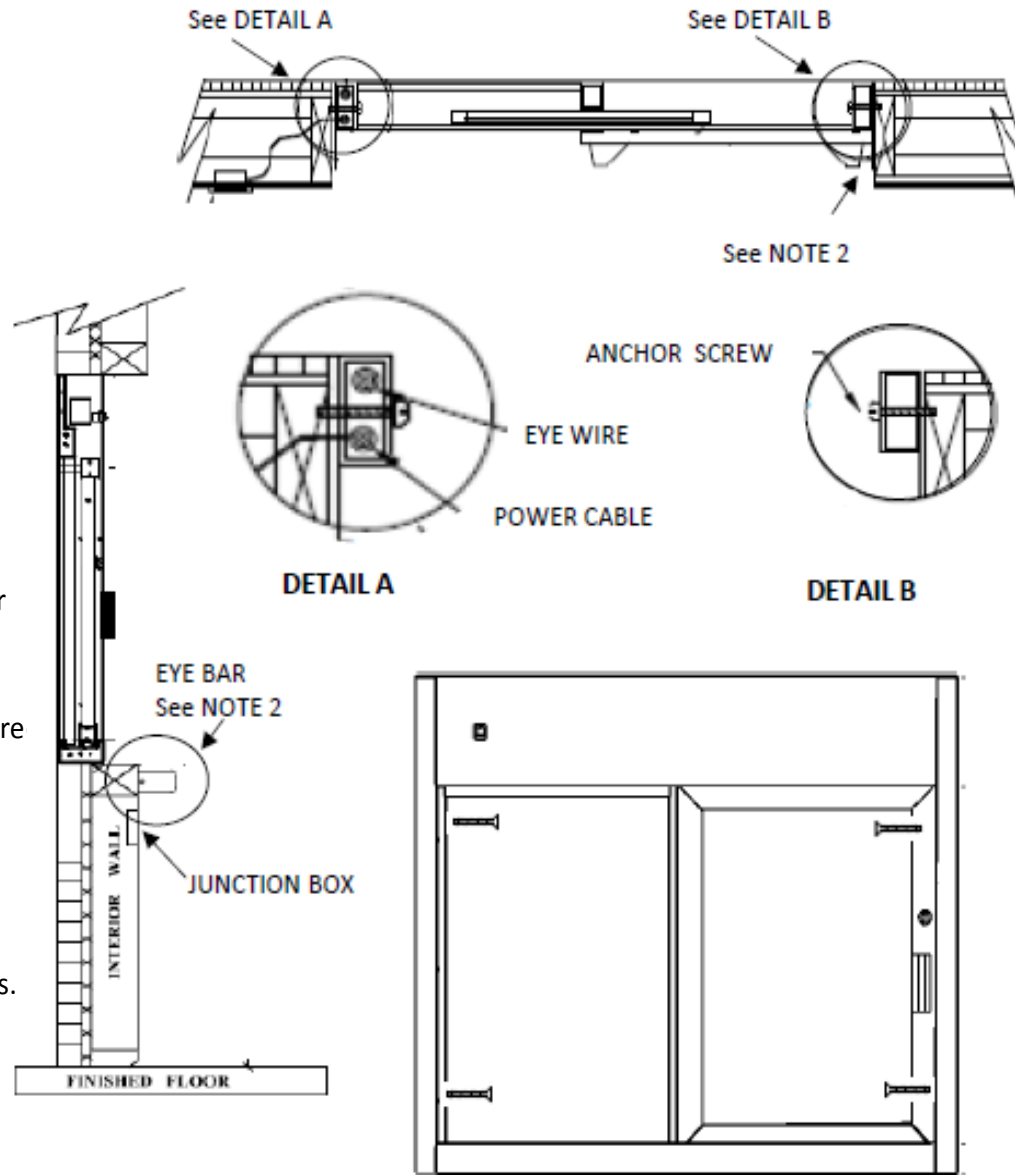


**TYPICAL  
SS-4035E-IP INSTALLATION**

- 1) Quikserv windows must be installed level and square to work properly.
- 2) Anchor per Florida Bldg. codes anchor schedule.
- 3) 115V/15 Amp. Dedicated circuit require
- 4) Recommended height from floor to service opening to be 36".  
(Check any and all local or city codes)
- 5) Silicone all exterior and interior joints.
- 6) All other type of anchoring to be approved by certified engineer.



**FIGURE 1**

**General Notes**

**Actual Dimension**  
48"(W) x 41"(H)

**Service Opening**  
20"(W) x 27"(H)

**Rough Opening**  
48-3/8"(W) x 41-3/8"(H)

**NOTE 1:**  
Anchor Screws to be supplied by contractor.

**NOTE 2:**  
Eye set to be mounted in the middle of the service opening. The outside edge should be in line with the outer edge of the side jamb of the operating door.

**NOTE 3:**  
The junction box for power supply to be supplied by contractor.

**CAUTION:**  
Use caution when drilling. The power supply cable is located in the left hand jamb.

**QUIKSERV**  
11441 BRITTMOORE PARK DR.  
HOUSTON, TX., 77041

TITLE: <b>INSTALLATION PROCEDURE</b>				
Drawing Name: <b>SS-4035E-IP INSTALLATION DRAWING</b>				
DATE	DRAWN BY	SCALE	SHEET	SIZE
07/12/2016	RBV	NTS	1 of 1	<b>A</b>

**NOTE: THIS DRAWING EMBODIES A CONFIDENTIAL PROPRIETY DESIGN ORIGINATED AND OWNED BY QUIKSERV CORP., AND IS SUBMITTED UNDER A CONFIDENTIAL RELATIONS ALL PATENT, MANUFACTURING, SALE RIGHTS REGARDING THE SAME ARE RESERVED EXCEPT TO THE EXTENT RIGHTS ARE EXPRESSLY GRANTED TO OTHERS. THE RECIPIENT AGREES BY ACCEPTING HIP. THESE DRAWINGS NOT TO SUPPLY OR DISCLOSE ANY INFORMATION REGARDING THEM TO ANY UNAUTHORIZED PERSON.**